

Pittsburg County, Oklahoma  
**COUNTY PURCHASING OFFICE**  
 Pittsburg County Court House  
 McAlester, Oklahoma  
 Phone: (918) 423-4934

**INVITATION TO BID**

PLEASE REVIEW TERMS AND CONDITIONS ON REVERSE SIDE RELATING TO SUBMISSION OF THIS BID.

Notarized Affidavit completions and signature required on reverse side.

DATE ISSUED	<b>11-Apr-16</b>
PAGE 1 OF	

BID NUMBER <b>Bid # 22</b>	BID CLOSING DATE AND HOUR <b>April 25, 2016 @ 10:00AM</b>	REQUIRED DELIVERY DATE Days after award of Purchase Order
TERMS:		DATE OF DELIVERY:

Item	Quantity	Unit of issue	DESCRIPTION	Unit Price	Total
			<p><b>Pittsburg County wishes to advertise for the following for the Tannehill Volunteer Fire Department:</b></p> <p><b>One (1) New 70 Gallon Tank, 5 Gallon Foam Cell (Skid Unit) for Wildland UTV</b></p> <p><b>See Specifications Attached</b></p>		

**TERMS AND CONDITIONS**

- 1. Sealed bids will be opened in the Commissioner's Conference Room, Pittsburg County Courthouse, McAlester, Oklahoma, at the time and date shown on the invitation to bid form.
- 2. Late bids will not be considered. Bids must be received in sealed envelopes (one to an envelope) with bid number and closing date written on the outside of the envelope.
- 3. Unit prices will be guaranteed correct by the bidder.
- 4. Firm prices will be F.O.B. destination.
- 5. Purchases by Pittsburg County, Oklahoma, are not subject to state or federal taxes.
- 6. This bid is submitted as a legal offer and any bid when accepted by the County constitutes a firm contract.
- 7. Oklahoma laws require each bidder submitting a bid to a county for goods or services to furnish a notarized sworn statement of non-collusion. A form is supplied below.
- 8. Bids will be firm until delivered.

(DATE)

AFFIDAVIT: I, the undersigned, of lawful age, being first duly sworn on oath say that he (she) is the agent authorized by the bidder to submit the above bid. Affiant further states that the bidder has not been a party to any collusion among bidders in restraint of freedom of competition by agreement to bid at a fixed price or to refrain from bidding; or with any state official or employee as to quantity; quality or price in the prospective contract or any other terms of said prospective contract; or in any discussions between bidders and any state official concerning exchange of money or other thing of value for special consideration in the letting of a contract; that the bidder/contractor has not paid, given or donated or agreed to pay, give or donate to any officer or employee of the State of Oklahoma (or other entity) any money or other thing of value, either directly or indirectly in the procuring of the award of a contract pursuant to this bid.

Subscribed and sworn before this \_\_\_\_\_ day  
of \_\_\_\_\_ 20\_\_\_\_\_ (seal)

My commission expires \_\_\_\_\_ Signed by: \_\_\_\_\_ Firm: \_\_\_\_\_ Title: \_\_\_\_\_  
(MANUAL SIGNATURE OF UNDERSIGNED)

\_\_\_\_\_  
NOTARY PUBLIC (CLERK OR JUDGE) Address: \_\_\_\_\_ Phone: \_\_\_\_\_  
City: \_\_\_\_\_ State \_\_\_\_\_  
Zip \_\_\_\_\_

NOTE: Other terms and conditions can be added at the discretion of the county officers.

"Corrected"  
RESOLUTION #16-200  
To Advertise

The Board of County Commissioners, Pittsburg County, met in regular session on Monday, April 11, 2016.

WHEREAS, Pittsburg County wishes to advertise for the following for the Tannehill Volunteer Fire Department:

One (1) New 70 Gallon Tank, 5 Gallon Foam Cell (Skid Unit) for Wildland UTV

A bid package containing complete specifications and an "Invitation to Bid" are available at the Pittsburg County Clerk's Office, 115 E. Carl Albert Parkway, Room 103, McAlester, Oklahoma 74501 or online at [pittsburg.okcounties.org](http://pittsburg.okcounties.org).

THEREFORE, each competitive bid submitted to the County must be accompanied with an affidavit for filing with the competitive bid form, as required by 61 O.S. § 138.

Sealed bids will be received and filed with the Pittsburg County Clerk and opened on Monday, April 25, 2016 at 10:00 a.m. in the Board of County Commissioners Conference Room, Pittsburg County Courthouse, 115 E. Carl Albert Parkway, McAlester, Oklahoma. Contract will be awarded to the lowest or best bidder. The Board of County Commissioners, Pittsburg County, reserves the right to reject any and all bids and re-advertise.

BOARD OF COUNTY COMMISSIONERS  
PITTSBURG COUNTY, OKLAHOMA


  
\_\_\_\_\_  
CHAIRMAN

  
\_\_\_\_\_  
VICE-CHAIRMAN

  
\_\_\_\_\_  
MEMBER

ATTEST:



  
\_\_\_\_\_  
COUNTY CLERK

SPECIFICATIONS  
FOR  
TANNEHILL-SCIPIO-LAKE AREA  
FIRE DEPARTMENT

FOR  
70 GAL. TANK  
5 GAL. FOAM CELL  
FOR WILDLAND UTV

## WATER TANK

The water tank shall be constructed of ½" thick polypropylene with polymer Co-pp (tm) resin. Water tank shall be welded with Heavy duty extruded joint. The material shall be certified, high quality, non-corrosive stress relieved thermo plastic, black in color with a texture finish, and UV stabilized for maximum protection. The skid type water tank shall be of a standard configuration and shall be so designed to have complete modular slide in capability. The tank shall have swash partitions welded inside tank in accordance with the latest NFPA requirements and shall allow for maximum water and air flow. The rear of tank shall have built in sight gauges for water and foam. The tank shall have 2 booster reel mounting blocks on top of tank that shall accommodate 2 sliding nut fasteners per block. The blocks shall be welded so that the hose reel mounts so operation of the hose reel is from side to side of UTV. The tank shall have 1-1" port for recirculating and 1-1" port for tank drain. The dimensions shall be 42.5" long and x 48" wide.

### Tank capacity

The tank shall have a capacity of 65 gallon water and a 5 gallon foam capacity.


### Fill tower

The tank shall have a fill tower for both water and foam. The tank shall also have an overflow/vent.

The fill tower covers shall be constructed of heavy duty material to withstand harsh working conditions and shall be screw on/off style.

The fill tower for the foam cell shall be constructed so no foreign material shall get into the foam cell.

The fill towers shall be on the front of tank.

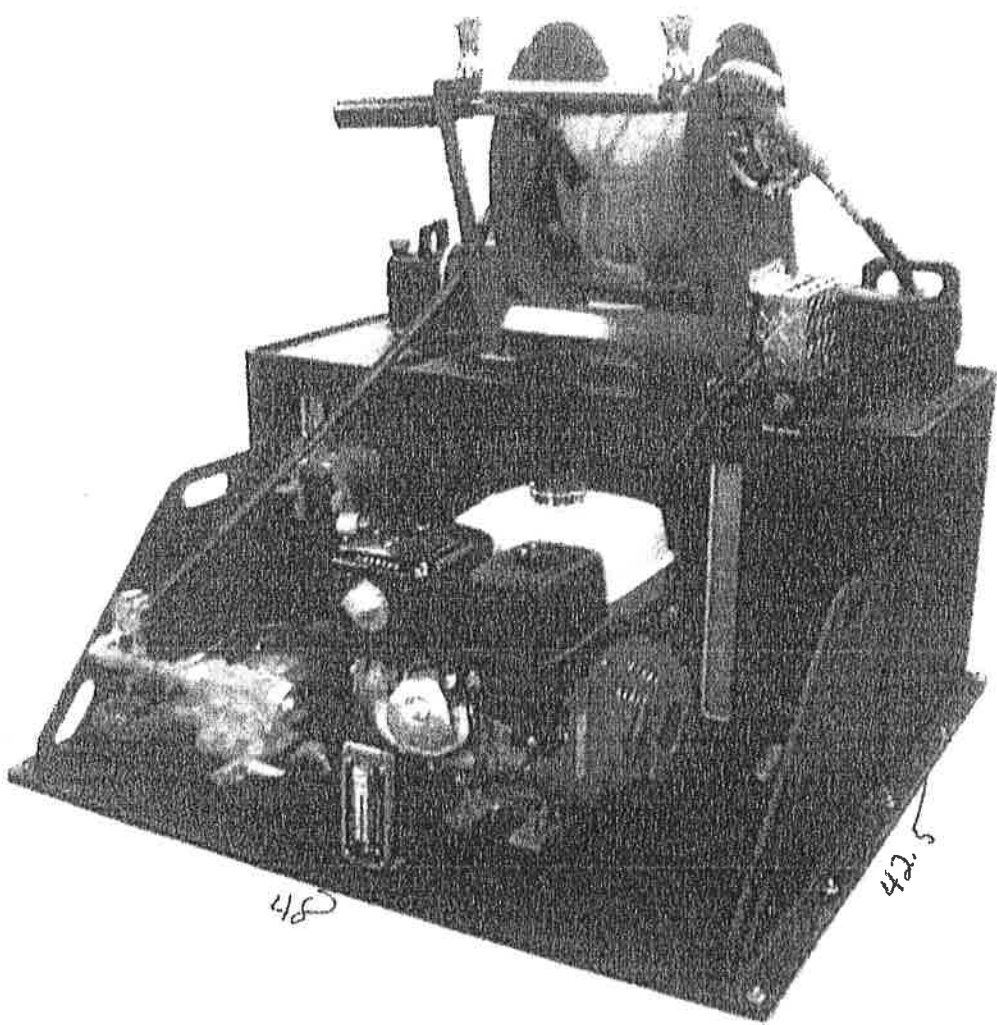

CLOSE X

#### PUMP and MOTOR

This unit shall have a Honda Engine or equivalent to with electric start and recoil start and shall have a Horse Power as per pump manufactures recommendations for maximum pressure and gallons per minute.

Pump shall be ultra-high pressure with UHP foam system capable of 10GPM at 1400 PSI. Pump shall have relief valve, and a foam proportion control module.

#### PLUMBING

This unit shall be plumbed to withstand pressures up to 1400PSI.

#### HORSE REEL

A horse reel with electric rewind shall be supplied and mounted to the top of the tank supplied with rollers on both sides of the hose reel.

#### HOSE

This unit shall have 100 FT of ½" high pressure hose.

#### NOZZLE

This unit shall be supplied with 1 dual action foam spray gun with hold down brackets attached to the inside floor and tank stabilizer on passenger side of brace.

#### WARRANTY

All MFG warranties shall be included with unit.